


111120-00

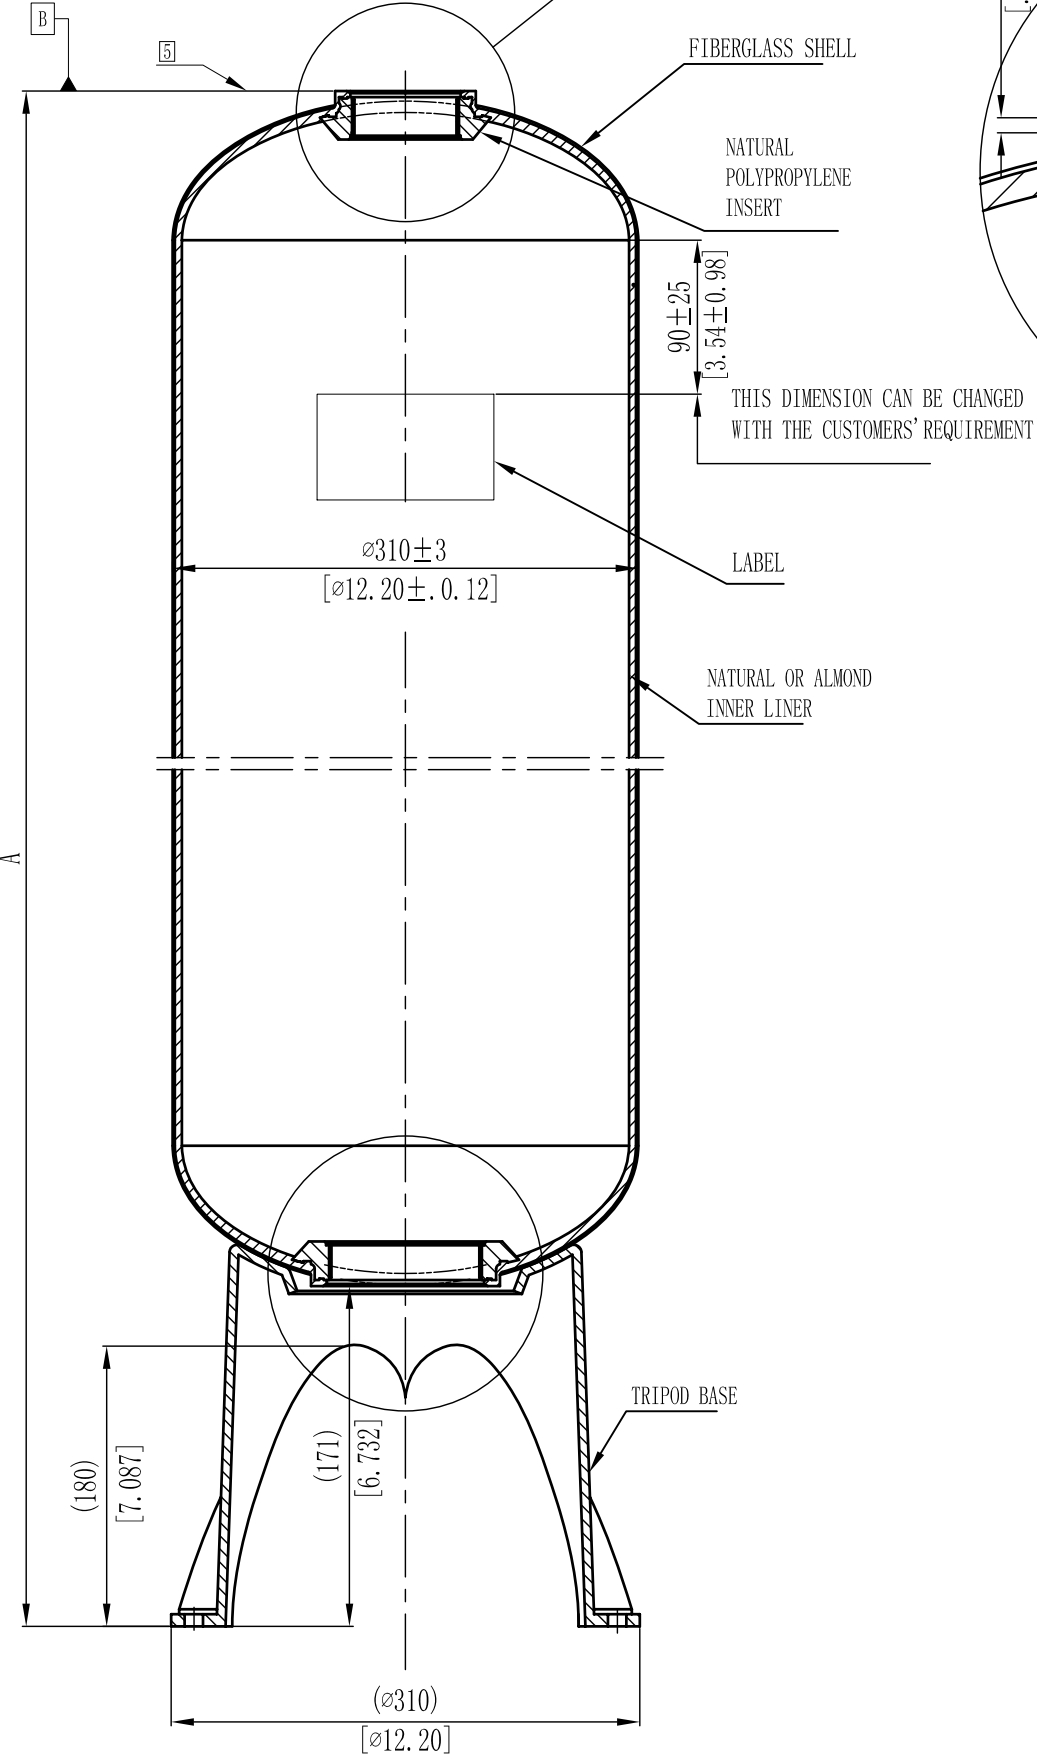

4''-8UN

0.6mm (.024") B

30°

$(\varnothing 101.7^{+0.1}_{-0.1})$

$[\varnothing 4.004^{+0.039}_{-0.004}]$

$(\varnothing 109.3 \pm 0.3)$

$[\varnothing 4.303 \pm 0.012]$

$(\varnothing 129.5 \pm 1)$

$[\varnothing 5.098 \pm 0.039]$

4 ± 0.25

$[\varnothing 158 \pm 0.01]$

NOTES:

1. TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
2. OPERATING SPECIFICATIONS:
 - A. MAXIMUM WORKING PRESSURE - 150 PSI (10.5 BAR)
 - B. TEMPERATURE RANGE - 34-120° F (1-49°C)
 - C. MAXIMUM VACUUM - 5"Hg (127mm Hg)
3. VISUAL LINER INSPECTION
 - A. NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - B. NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3×3mm.
 - C. NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED.
4. ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED.
5. SURFACE TO BE FREE OF NICKS, SCRATCHES, RESIN AND GLASS.
6. DIMENSIONS IN PARENTHESIS ARE REFERENCE ONLY.
7. DIMENSIONS IN SQUARE PARENTHESIS ARE INCH UNIT.
8. USING A STANDARD LEVEL WITH TANK POSITIONED ON A LEVEL SURFACE, DATUM B TO BE PARALLEL WITH DATUM A. BUBBLE OF LEVEL MUST FALL COMPLETELY WITHIN LINES WHEN MEASURED AT 90° INTERVALS.

LENNTECH
info@lennotech.com Tel. +31-152-610-900
www.lennotech.com Fax. +31-152-616-289

info@lenntech.com Tel. +31-152-610-900
www.lenntech.com Fax. +31-152-616-289

1	THIS DRAWING IS UPDATED COMPLYING WITH THE CHINESE VERSION				2009/06/11	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE
REFERENTIAL PLASTIC SHRINKAGE (IF NECESSARY):			 WAVE CYBER (SHANGHAI) CO., LTD.			
SIGNATURE						
	NAME	DATE				
DESIGN			SCALE	MATERIAL	MODEL	
INSPECTION			1 : 5		DESCRIPTION	
APPROVAL			QUANTITY	SMOOTHNESS	12" (2.5-4) FRP PRESSURE VESSEL	
THIS PRODUCT DRAWING CAN NOT BE COPIED AND/OR USED WITHOUT PRIOR WRITTEN APPROVAL OF WAVE CYBER.			PROJECTION	COMPUTER CODE	DRAWING NO.	VERSION NO.
					111120-00	1
DO NOT MEASURE THE DIMENSIONS.				UNIT: MM	TOTAL PAGE: 1	